

DOMINATOR

REMOTE START/STOP CONTROLLER

OVERVIEW

South Australian MFS Policy 006 mandates that if the fire pump is remote from the building's main FIP, then a remote control and indication panel must be mounted at the main FIP location— but only if the site layout requires it. This positioning must be discussed with MFS to confirm applicability.

FEATURES

- Designed to meet AS 2941-2013
- Designed to Comply with S.A MFS 006 Policy
- IP65 Enclosure Rating





OPERATION

- Auto/Local/Start selector switch positions
- Emergency STOP push button



WIRING DIAGRAM

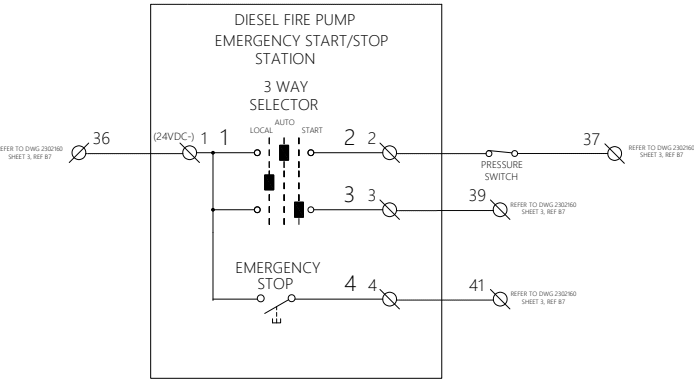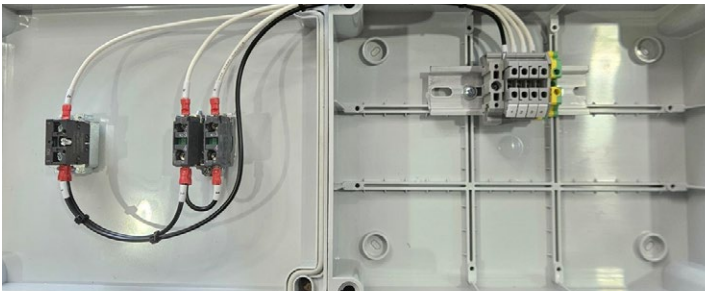


VOLTAGE	PRODUCT CODE	DESCRIPTION
24VDC-	TBA	Diesel Fire Pump Emergency Start/Stop Station – SA Policy 006



35 YEARS INDUSTRY EXPERIENCE

ALL
PURPOSE
PUMPS
PRECISION
ENGINEERED
TO FLOW...



T +61 3 8368 0000
www.appumps.com.au